



Versaflex[®] Si



Premier Silica Dispersant

Nouryon



Versaflex Si silica dispersant

Water treatment chemical to prevent the formation of hard-to-remove silica and silicate scales.

Designed for use with today's cooling water systems

Chemical treatment of cooling water systems has undergone significant changes over the past 30 to 40 years. Driven by higher population densities and the need to conserve limited fresh water supplies, process water users strive constantly to maximize water reuse and minimize generation of waste streams. One way to achieve these objectives, of course, is to increase cooling water cycles.

One problem with this approach, however, is that naturally occurring salts normally dissolved in fresh water—especially salts with relatively low solubilities, such as calcium carbonate, calcium phosphate, calcium sulfate and silica/silicates, for example—become increasingly concentrated as water evaporates during each recirculation cycle. When this occurs, these soon reach their maximum levels of solubility and can begin to settle out as scale on equipment surfaces, fouling the cooling systems and decreasing their efficiency. To prevent this, suppliers of water treatment chemicals have developed ways to keep such salts in solution at concentrations well beyond their normal solubility levels, allowing process water to be recirculated at higher cycles than could normally be achieved without fouling.

Technologies for control of calcium carbonate, calcium phosphate and calcium sulfate have, in fact, become well established. These technologies include:

Mineral salt	Chemical treatment
CaCO ₃	Phosphonates, acrylic or maleic polymers
Ca(PO ₄) ₂	Sulfonated copolymers
CaSO ₄	Acrylic or maleic copolymers

Nouryon, a leader in advanced water treatment technology, offers a polymer called Versaflex® ONE that makes possible simultaneous control of both calcium carbonate and calcium phosphate at the higher pH levels at which modern cooling systems are normally operated to prevent corrosion.

To date, technologies for effective, economical control of silica/silicate scale have not been available, even though such scale, once formed, is unquestionably the most difficult to remove for the following reasons:

- Silica/silicate forms the hardest of all scales and is therefore the most damaging to the cooling system.
- Silica/silicate scale can occur throughout the entire system, even in difficult-to-reach places.
- Silica/silicate scale, because it is relatively inert, cannot be removed by traditional acid cleaning methods.

The only effective cleaner for silica/silicate scale is hydrofluoric acid (HF), an especially aggressive and hazardous chemical to handle. Mechanical cleaning is labor intensive, time consuming and physically damaging to the cooling system.

Silica/silicate scaling is especially problematic in the regions of the Pacific Rim, where volcanoes are currently active or where volcanic activity has occurred in the past. The ground or surface water in these regions can easily contain SiO₂ in concentrations up to its normal solubility limit (120ppm at 25°C and pH 8.5). At this level, some of the systems that can be affected by silica/silicate scaling include:

- Open recirculating cooling water systems
- Steam generating systems
- Reverse osmosis systems
- Geothermal systems

Adding to the complexity of the problem, it is well known that naturally occurring silica can polymerize to form amorphous or colloidal silica under super saturation conditions. It can also precipitate with metal ions to form silicates of magnesium, calcium, iron or aluminum. It can even be present in different chemical and physical forms, depending on water chemistry, pH, temperature and the presence or absence of suspended solids.

Because of this, silica fouling is very complex and difficult to predict. In fact, there are currently no standard or generally accepted laboratory test methods to study silica fouling problems or to evaluate potential additives that may help to alleviate the problem. Using a combination of molecular modeling and exhaustive field trials, however, Nouryon has developed a polymer that is very effective at high cycles of concentration.


Molecular modeling

Nouryon is a worldwide supplier of custom-designed specialty polymers for all varieties of water treatment applications. Our polymer technology has solved customers' application complications ranging from adhesives to foods to microelectronics. Nouryon has sophisticated research instrumentation and techniques, including those necessary for molecular modeling.

As a result, we are uniquely equipped to not only develop new specialty polymers for specific applications, but also to study the interactions of different polymers with the metallic ions and other chemical structures they are designed to control.


Applying this capabilities expertise, we were able to synthesize three different polymers containing functional groups theoretically capable of interacting with polymeric silica and metallic silicate salts to keep them in solution at concentrations far exceeding their normal solubilities. We designated these Polymers A, B and C and proceeded to conduct tests that would indicate which one would be most effective with the most commonly encountered forms of silica. Schematic diagrams of these three polymers, including their different functional groups, are shown in Figure 1.

Figure 1: Polymers studied

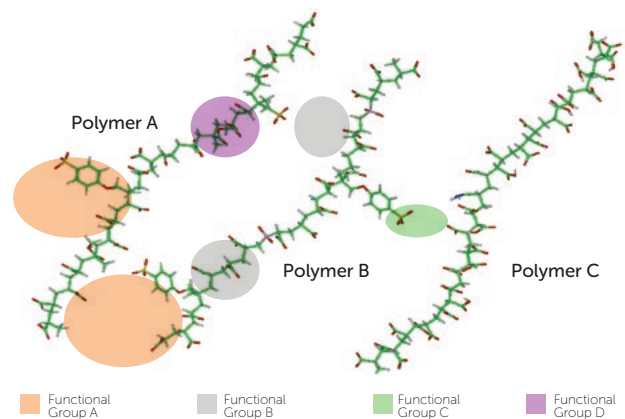


Because silica can exist in cooling water both as polymeric silica and as silicate salts, it was necessary to explore the interactions of each of the three experimental polymers with both forms of silica. Schematic diagrams of both forms are shown in Figure 2.

Figure 2: Inorganic substrates

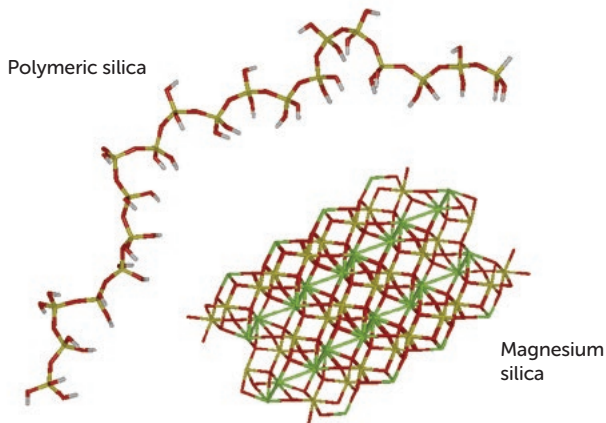

A schematic diagram of the interaction between experimental Polymer A and polymeric silica is shown in Figure 3.

Figure 3: Molecular interactions between Polymer A and polymeric silica

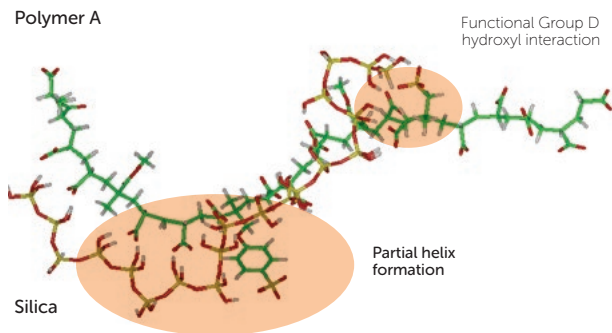

A schematic diagram of the interaction between experimental Polymer B and C and polymeric silica is shown in Figures 4 and 5.

The lower the interaction energy between the experimental polymer and the polymeric silica or magnesium silicate crystals, the stronger the interaction between the polymer and the scale surface, leading to better dispersion behavior. Because of this, the schematic diagrams to the left illustrate the lowest-energy interactions between the different experimental polymers and magnesium silicate crystals.

Figure 4: Molecular interactions between Polymer B and polymeric silica



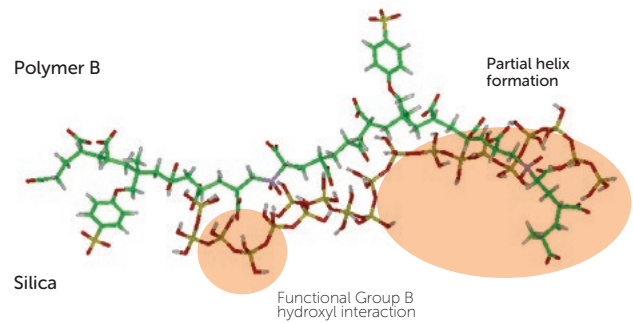


Figure 5: Molecular interactions between Polymer C and polymeric silica

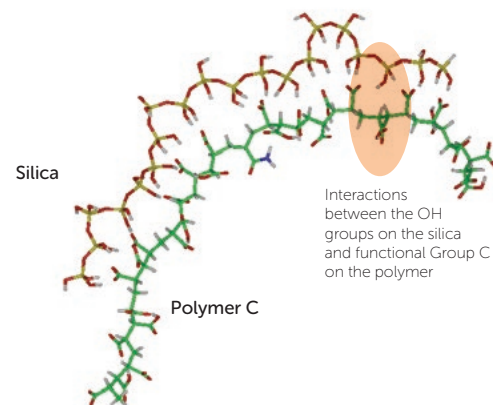


A schematic diagram of the interaction between experimental Polymer A and magnesium silicate crystals is shown in Figure 6.

Figure 6: Low-Energy Polymer A – magnesium silicate pair configuration

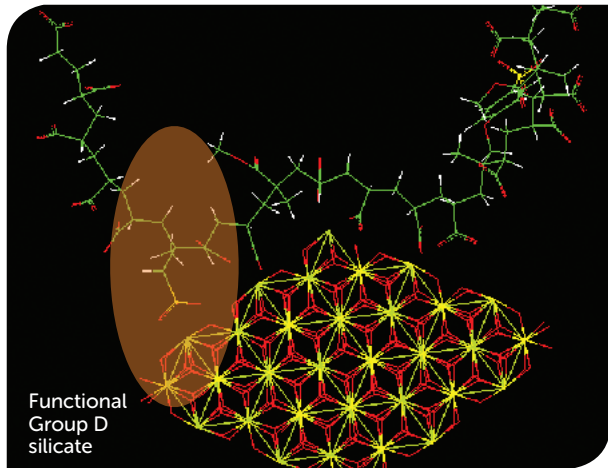


A schematic diagram of the interaction between experimental Polymer B and magnesium silicate crystals is shown in Figure 7.

Figure 7: Molecular interactions between Polymer B and magnesium silicate

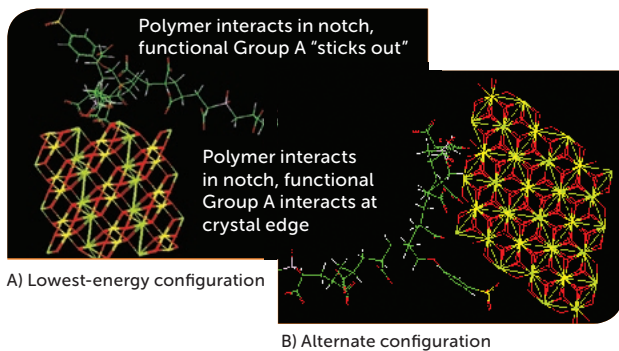

A schematic diagram of the interaction between experimental Polymer C and magnesium silicate crystals is shown in Figure 8.

Figure 8: Low-energy Polymer C – magnesium silicate pair configuration

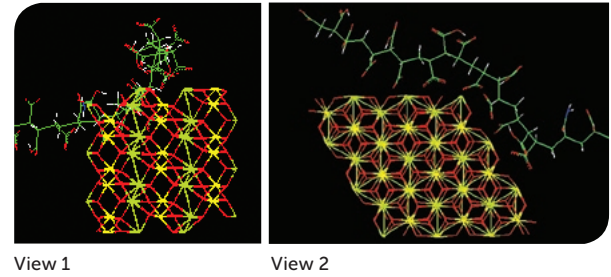

The quantum mechanical calculation of the interaction energies between each of the experimental polymers and the silica/silicate surfaces shown in Figures 3 through 8 yielded the following energy values:


Polymer	Surface	Interaction energy Kj/mole
C	-{OSi(OH) ₂ }-	-530.7
C	MgSiO ₃	-615.5
A	-{OSi(OH) ₂ }-	-552.6
A	MgSiO ₃	-692.9
B	-{OSi(OH) ₂ }-	-618.7
B	MgSiO ₃	-858.7

As noted above, the more negative the calculated energy, the stronger is the interaction between the polymer and the scale surface, leading to better dispersion behavior. Therefore, Polymer B represents the best silica and silicate dispersant of the three polymers evaluated and was thus selected for further evaluation in pilot plant cooling tower tests and field trials.

Pilot plant testing

In order to compare the actual performance of the new experimental polymer, Versaflex Si, with its theoretical performance as determined by quantum mechanical calculations, it was evaluated in a laboratory scale pilot plant cooling tower. The apparatus itself is constructed of PVC, and the fill is the standard honeycomb normally used in commercial cooling towers. A schematic diagram of the pilot plant cooling tower is shown in Figure 9.

Figure 9: Pilot plant cooling tower schematic

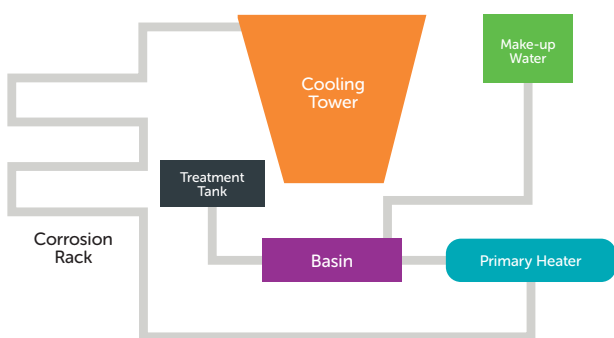

Conducting laboratory tests using synthetic water dosed with sodium silicate to evaluate silica dispersants is generally regarded as difficult because silica exists in more than eleven different forms and thus cannot be accurately represented by laboratory-spiked sodium silicate. Because of this, naturally occurring water from the city of Madera in Southern California, an area where silica/silicate scaling is generally regarded as a problem, was used as make-up to gradually concentrate silica in the evaporative cooling system under simulated conditions.

During preliminary pilot cooling tower testing using hard water as make-up, it was observed that calcium hardness levels reached the break point and calcite precipitation began to occur, causing apparent co-precipitation of silica, after reaching a level of 250 ppm SiO₂ in the tower water. When using partially softened water as make-up to avoid potential calcite interference, however, no calcite or silica scale formation was observed throughout the test period.

The chemical composition of the partially softened make-up water was as follows.

Calcium hardness	28 ppm as CaCO ₃
Magnesium hardness	12 ppm as CaCO ₃
Silica	56.5 ppm as SiO ₂
Total alkalinity	88 ppm as CaCO ₃
Chloride	36 ppm as Cl ⁻
Phosphate	0.57 ppm as PO ₄
Iron	0.001 ppm as Fe
Specific conductance	240 mmhos
pH	7.9


The treatment and test conditions were as follows:

PBTC	3.3 ppm active
HEDP	4.8 ppm active
TTA	2.0 ppm active
Versaflex Si	18.0 ppm active
Biocide	150 ppm 1.5% Isothiazoline slug dosed every 2 days
Temperature	82° – 92°F
Flow rate	3.0 gpm



During the pilot cooling tower test, samples were taken every two days and tested for molybdate-reactive silica levels as well as calcium and magnesium hardness. The results, shown in Figure 10, demonstrate the ability of Versaflex Si to significantly increase the solubility of silica in cooling water systems.

Figure 10: Results of pilot cooling tower test

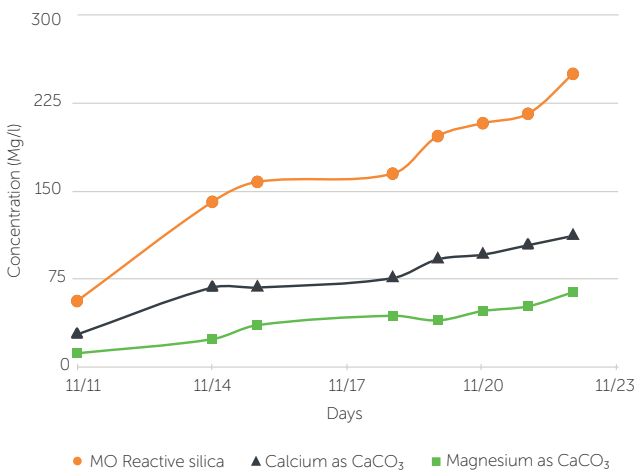

By comparison, the same test was conducted using no silica dispersant at all and again using a competitive product at a level of 22-44 ppm active. The results were as follows.

Silica dispersant dosage	Maximum SiO ₂ achieved
Blank (no dispersant)	150 ppm
Competitive product as 22-44 ppm active	180 ppm
Versaflex Si at 11-20 ppm active	>250 ppm

Since pilot cooling tower tests indicated the superior effectiveness of Versaflex Si under simulated conditions, field trials were run to demonstrate its performance under real-world conditions.

Field trial testing

A comfort cooling system in the Northwest (Spokane, WA) and a process cooling system in the Southwest (Southern Arizona) were chosen as locations in which to conduct field trials of Versaflex Si under real-world conditions.

Field trial #1

For the first field trial, the chemical composition of the make-up water was as follows:


Calcium hardness	12 ppm as CaCO ₃
Magnesium hardness	8 ppm as CaCO ₃
Silica	48.5 ppm as SiO ₂
Total alkalinity	128 ppm as CaCO ₃
Chloride	34 ppm as Cl ⁻
Iron	0.16 ppm as Fe
Specific conductance	240 mmhos
pH	7.8

The treatment and test conditions were as follows:

HEDP	6.0 ppm active
TTA	2.0 ppm active
PAA	5.0 ppm active
Versaflex Si	20 ppm active
Biocide	150 ppm 1.5% Isothiazoline slug dosed every 2 days
Temperature	80°F
- T	10°F
Circulation rate	720 gpm
Evaporation rate	1008 gpd


The trial schedule was set at seven weeks, with recirculation cycles increasing from 3.0 to 6.0 cycles at the rate of 0.5 cycles per week throughout the trial period. As expected, the hardness of the tower water increased with each recirculation cycle as magnesium and calcium salts (calculated as CaCO₃) became more concentrated as shown in Figure 11.

Figure 11: Field trial #1 – hardness

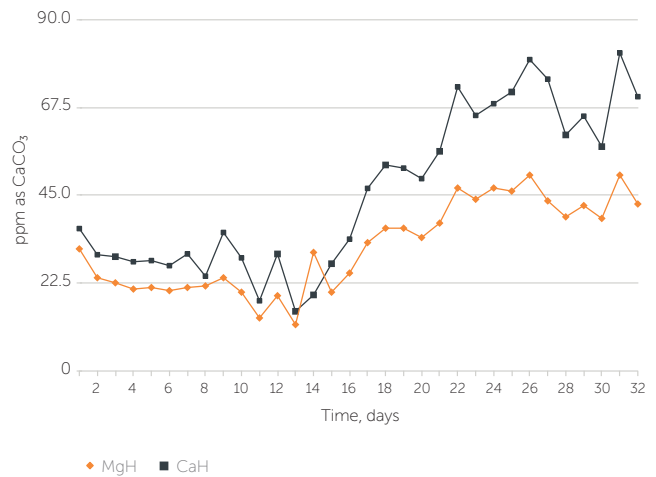


As also expected, the conductivity of the tower water increased as soluble salts became more concentrated with each recirculation cycle, as shown in Figure 12.

Figure 12: Field trial #1 – conductivity

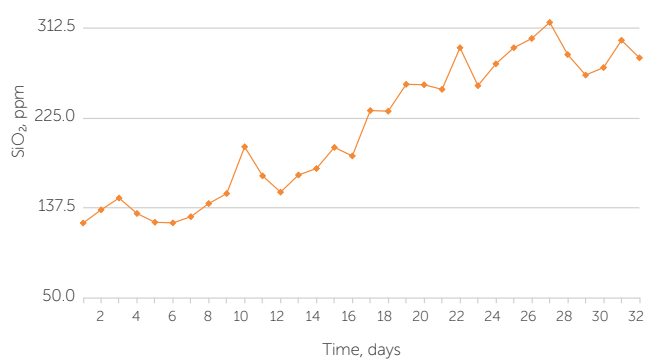


During the field trial, the total alkalinity of the tower water also increased with each recirculation cycle, as shown in Figure 13.

Figure 13: Field trial #1 – total alkalinity

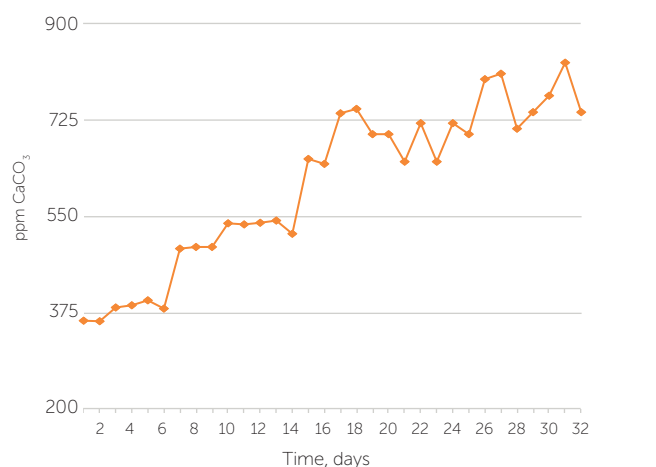


As both conductivity and total alkalinity increased significantly, however, the pH of the tower water increased only slightly as shown in Figure 14.

Figure 14: Field trial #1 – pH vs conductivity/alkalinity cycles

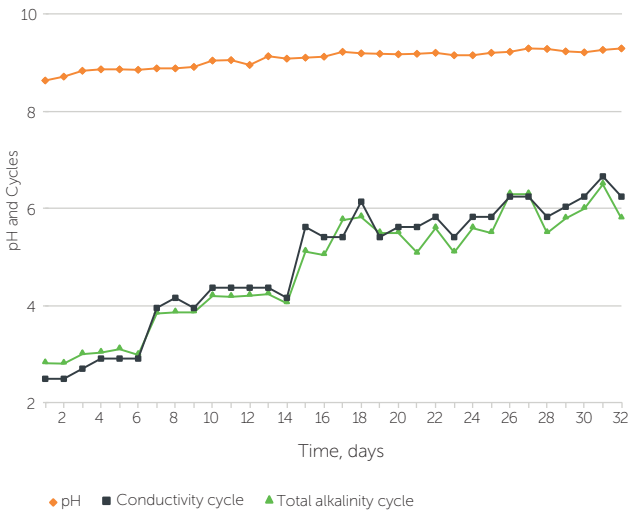

At the same time, the presence of Versaflex Si silica dispersant allowed an increase in silica levels in the cooling tower water from 132 ppm to >300 ppm SiO₂ without scale formation as shown in Figure 15.

Figure 15: Field trial #1 – silica

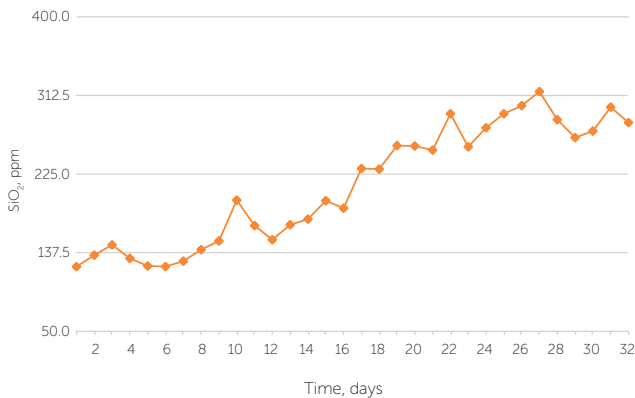

This represents an increase in cycles of concentration from 2.8 to 6.5 with 100% silica retention, far exceeding the target performance the project was designed to demonstrate.

In fact, it was observed during the course of the field trial that because of the presence of Versaflex Si silica dispersant, the limiting factor of the cooling water began to shift from silica to calcium hardness during severe water conditions as shown in Figure 16.

Figure 16: Field trial #1 – cycles of concentration



Overall, at the end of this field trial, the direct cost savings for the system were calculated as follows:

- Make-up water demand reduced by 24%
- Blowdown water (waste water) reduced by 68%
- Treatment usage reduced by 58%

Field trial #2

Field trial #2 was conducted at a power plant cooling tower plagued with silica fouling problems even though the make-up water contained only 22 ppm SiO₂ and the cooling water was running at 4 cycles of concentration.

For the second field trial, the chemical composition of the make-up water was as follows:

Calcium hardness	160 ppm as CaCO ₃
Magnesium hardness	80 ppm as CaCO ₃
Silica	22 ppm as SiO ₂
Total alkalinity	192 ppm as CaCO ₃
Chloride	112 ppm as Cl ⁻
Iron	0.01 ppm as Fe
Specific conductance	520 mmhos
pH	6.8

The test conditions were as follows:

Equipment	On-site evaporative deposition test rig with automatic acid feed, inhibitor feed and blowdown
Heat exchanger	Copper nickel tube, 145° F skin temperature
Treatment program	Proprietary formula + Versaflex Si silica dispersant
pH control	7.3–7.8
Test duration	30–90 days

Before the primary test was conducted, an evaporative deposition test was conducted on a side stream using competitive silica dispersant at 25 ppm active, which still produced silica fouling at 4 recirculation cycles. X-ray analysis of the deposit showed its identity and composition to be similar to that of the main plant heat exchanger deposit—i.e., Al, Si, Ca and Fe. This suggested that the deposit was, in fact, aluminum silicate, consistent with airborne dust/dirt/silt caused by frequent dust storms in the desert.

During the primary test, when the system was switched to new Versaflex Si Silica Dispersant at only 9 ppm active, no apparent deposits occurred either during or after the dust storms. The heat exchanger remained clean even when recirculation was increased from 4 to >6 cycles with half the water velocity over the heated tube. Dispersion of silt at high-dust loadings was seen as a surprising benefit of the new silica dispersant.



Versaflex Si – an effective silica dispersant

Molecular modeling studies, pilot plant cooling tower tests and exhaustive field trials have all demonstrated that new Versaflex Si silica dispersant is able to increase silica solubility by more than 2.5 times, allowing cooling systems to run at higher cycles of concentration without experiencing troublesome silica fouling.

Because silica exists in so many different forms, however, it is highly recommended that a program of actual field trials be implemented in order to determine the optimum concentrations and system conditions for use of Versaflex Si.

Safety and handling

Versaflex Si products are available in bulk, intermediate bulk and 55-gallon drums. The standard drum is fiber with 525 pounds net. Plastic drums are also available.

Versaflex Si polymers have very low toxicity. Consult product MSDS for further information.

Contact with the skin or eyes should be avoided. If a Versaflex Si product contacts the eyes, flush with water. If redness or sensitivity occurs and persists, consult a physician.

Versaflex Si polymers should be shipped and stored in 304 stainless steel or better, fiberglass or plastic tanks. Certain phenolic linings are acceptable for use in drums and storage tanks. Mild steel, copper, brass and aluminum should not be used.

The above materials of construction also apply to all pipes, valves and pumps used in the application or transport of Versaflex Si.

Contact us directly for detailed product information and sample requests.

USA and Canada

Chicago, USA
T +1 800 906 9977

China

Shanghai, China
T +86 21 2220 5000

Europe

Stenungsund, Sweden
T +46 303 850 00

South America

Itupeva, Brazil
T +55 11 4591 8938

South East Asia

Singapore
T +65 6635 5183

Middle East

Dubai, United Arab Emirates
T +971 (0) 4 2471500

Central America and Caribbean

Mexico City, Mexico
T +52 55 5261 7895

India

Mumbai, India
T +91 22 6842 6700

Russia

Moscow, Russia
T +7 495 766 1606

About Nouryon

We are a global specialty chemicals leader. Markets worldwide rely on our essential chemistry in the manufacture of everyday products such as paper, plastics, building materials, food, pharmaceuticals, and personal care items. Building on our nearly 400-year history, the dedication of our 10,000 employees, and our shared commitment to business growth, strong financial performance, safety, sustainability, and innovation, we have established a world-class business and built strong partnerships with our customers. We operate in over 80 countries around the world and our portfolio of industry-leading brands includes Eka, Dissolvine, Trigonox, and Berol.

For more information visit surfacechemistry.nouryon.com

All information concerning our products and/or all suggestions for handling and use contained herein (including formulation and toxicity information) are offered in good faith and are believed to be reliable. However, Nouryon makes no warranty express or implied (i) as to the accuracy or sufficiency of such information and/or suggestions, (ii) as to any product's merchantability or fitness for a particular use or (iii) that any suggested use (including use in any formulation) will not infringe any patent. Nothing contained herein shall be construed as granting or extending any license under any patent. The user must determine for itself by preliminary tests or otherwise the suitability of any product and of any information contained herein (including but not limited to formulation and toxicity information) for the user's purpose. The safety of any formulations described herein has not been established. The suitability and safety of a formulation should be confirmed in all respects by the user prior to use. The information contained herein supersedes all previously issued bulletins on the subject matter covered.

Products mentioned are trademarks of Nouryon and registered in many countries.

Nouryon

00514_060919